

LITERATURE REVIEW OF UNCERTAINTY OF ANALYSIS METHODS


(Cool Roofs)

Report to the
Texas Commission on Environmental Quality



Jeff S. Haberl, Ph.D., P.E.
Soolyeon Cho

October 2004
Revised November 2004

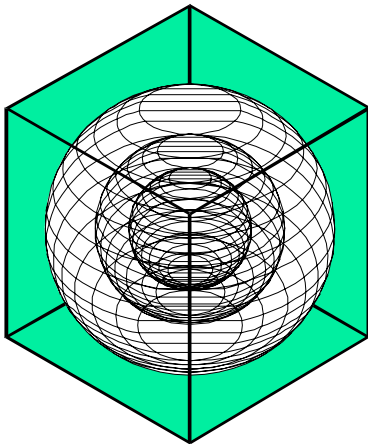

ENERGY SYSTEMS LABORATORY

Texas Engineering Experiment Station
Texas A&M University System

Disclaimer

This report is provided by the Texas Engineering Experiment Station (TEES) pursuant to Section 388.005 and Section 388.003, (2) (A) & (B) of the Texas Health and Safety Code and is distributed for purposes of public information. The information provided in this report is intended to be the best available information at the time of publication. TEES makes no claim or warranty, expressed or implied, that the report or data herein is necessarily error-free. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not constitute or imply its endorsement, recommendation, or favoring by the Energy Systems Laboratory or any of its employees. The views and opinions of authors expressed herein do not necessarily state or reflect those of the Texas Engineering Experiment Station or the Energy Systems Laboratory.

Acknowledgements

The Energy Systems Laboratory greatly appreciates the assistance and guidance provided by the staff at the Texas Commission on Environmental Quality on this report, especially the assistance of Mr. Steve Anderson. Assistance from Ms. Sherrie Hughes (ESL) and comments from Don Gilman (ESL), are gratefully acknowledged. This report completes one of the deliverables for the Emissions Calculator project, and is intended to comply with the TCEQ guidance *Guide for Incorporating Energy Efficiency/Renewable (EE/RE) Projects into the SIP, Feb. 2004*.

1 Executive Summary

In this literature review, seventy two (72) articles were reviewed from various sources, including: the literature compiled by the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE); literature listed on the web sites of the Florida Solar Energy Center (FSEC), the Oak Ridge National Laboratory (ORNL), the National Renewable Energy Laboratory (NREL), the Lawrence Berkeley National Laboratory (LBNL), the American Council for an Energy Efficient Economy (ACEEE), and the publications of Elsevier. Keywords searched were: cool roofs, radiant barrier, high-albedo, attic ventilation, duct, as well as the names of the most prolific authors in this area, Dr. Hashem Akbari (LBNL), and Mr. Danny Parker (FSEC).

Twenty-seven of seventy-two papers presented a quantitative cooling energy savings from cool roofs. In these twenty-seven articles cooling energy savings varied from 2% to 44% and averaged about 20%. Ten papers presented quantitative savings as the percent (%) savings of peak cooling energy use, two papers mentioned heating energy savings, or additional amounts of heating required. The literature indicated that the peak cooling energy savings from cool roofs are between 3% and 35%, which depends on ceiling insulation levels, duct placement and attic configuration.

Heating energy savings of 11% through 19% were reported for radiant barrier systems, which can reduce heat fluxes and, as a result, can reduce heat loss to the attic and to the outside of a building in the winter weather condition. One paper reported heating savings of 50%, which was stated to be an impact of the roof re-covering, rather than the cool roof systems alone.

More than half (fifteen) of the papers showing energy savings from cool roofs implemented white roof systems. Eight papers used radiant barrier systems for cool roofs. The applications of the cool roof systems were performed on different building types; eighteen papers were results from residential buildings, seven papers reported results from commercial buildings. No literature could be found on strictly industrial buildings that had quantitative savings. The literature reported that the implementation of cool roof systems was carried out in different climate conditions. However, most of these climates were in hot-humid zones of the United States.

Four of nine papers that reported quantitative results applied the white roof systems and showed heat flux reductions in the 20% to 72% range. Radiant barrier systems, used in four of the papers reviewed, had reduced heat gains from 8% to 98%. Photovoltaic roof systems were even utilized for cool roofs, and were reported to decrease cooling load by as much as 35% on a conventional roof. Applications for most of these papers were to residential buildings (seven of nine papers). One paper applied a white roof system to the commercial buildings along with the residential buildings.

Papers with qualitative analysis for the cool roof systems are also listed. Thirty-five papers showed cooling energy savings, two papers peak cooling savings, and five papers report heating savings from cool roofs. Applications were also mainly to the residential

buildings; seventeen papers to the residential buildings, four papers to the commercial buildings, and two papers to the industrial buildings. Cooling energy savings were also mentioned from the papers that focused primarily on the urban heat island effect. These papers mentioned that the cool roof systems contribute to the reduction of the heat island effect.

TABLE OF CONTENTS

1	Executive Summary	3
2	Summary	7
3	References.....	17

LIST OF FIGURES

<i>Figure 1. Map of DOE's Proposed Climate Zones (DOE, 2003)</i>	9
<i>Figure 2. Energy Balance on Roof Surface (WBDG, 2004)</i>	14
<i>Figure 3. Vented Attic Thermal Processes (FSEC, 2004a)</i>	14
<i>Figure 4. The barrier is installed horizontally over the attic frame. (HEM, 2004a)</i>	15
<i>Figure 5. The barrier is attached to the rafters that support the deck. (HEM, 2004b)</i>	15
<i>Figure 6. Typical Attic Section with Three Possible Locations for Radiant Barrier. (FSEC, 2004b)</i>	16

LIST OF TABLES

<i>Table 1. Cool Roof Literature Survey Reporting Quantitative Results</i>	8
<i>Table 2. Cool Roof Literature Survey Reporting Heat Flux Qualitative Results</i>	11
<i>Table 3. Qualitative Analysis of Cool Roof Literature Survey</i>	12

2 Summary

In the United States more than 90% of the roofs covering structures are dark-colored (EPA, 2004). Dark materials absorb more heat from the sun than light-colored materials. The surfaces on these low-reflectance roofs easily reach temperatures of over 180 F, and, as a result, in the summertime considerable heat energy penetrates into the non-ventilated attic, resulting in temperatures as high as 150 F during the peak of summer (Akridge, 1998). These dark roofs can contribute to the reduction of indoor comfort if there are inadequate insulation levels in the ceiling above the conditioned space. Likewise, they can increase of cooling energy and peak electricity demand, and, as a consequence, to the boost in NO_x emissions associated with the production of electricity in fossil fuel power plants.

In contrast to the dark roof systems, cool roofs reflect unwanted summer heat and can also radiate away thermal energy after being absorbed in the roofs. Cool roofs consist of a highly reflective roofing surface, which is referred to as a high-albedo or high thermal reflectance surface. In this literature review cool roof systems are discussed in terms of how much cooling and peak cooling energy they have been reported to save when compared to the conventional roofing systems.

To perform this literature review, seventy-two (72) articles were reviewed using several search engines, including: the literature compiled by the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE); literature listed on the web sites of the Florida Solar Energy Center (FSEC), the Oak Ridge National Laboratory (ORNL), the National Renewal Energy Laboratory (NREL), the Lawrence Berkeley National Laboratory (LBNL), the American Council for an Energy Efficient Economy (ACEEE), and the publications of Elsevier. Keywords searched were: cool roofs, radiant barrier, high-albedo, attic ventilation, duct, as well as the names of the most prolific authors in this area, Dr. Hashem Akbari (LBNL), and Mr. Danny Parker (FSEC).

Twenty-seven of seventy-two papers presented a quantitative cooling energy savings from cool roofs. As shown in Table 1, these cooling energy savings varied from 2% to 44% and averaged about 20%. Ten papers presented quantitative savings for peak cooling energy use, two papers mentioned heating energy savings, or additional amounts of heating required. The literature indicated that the peak cooling energy savings from cool roofs are between 3% and 35%, which depends on ceiling insulation levels, duct placement and attic configuration.

Year	Authors	Methods	Cooling Energy Savings (%)							Peak Cooling Energy Savings (%)							Heating Energy Savings (%)							Applications			Climatic Zones				
			10	20	30	40	50	60	70	10	20	30	40	50	60	70	10	20	30	40	50	60	70	Res.	Com.	Ind.					
1995	Parker et al.	Reflective roof coatings	3	---	---	44					22																x			2	
1994	Parker et al.	Reflective roof coatings		25	---	43						28															x			2	
1997	Parker et al.	Roof coloring		13	---	43																					x			2	
1995	Parker et al.	Reflective roof coatings	2	---	---	43					22																x			2	
1997	Parker & Barkaszi	Roof coating				40																					x			2	
1987	Wu	Radiant barriers				40																					x			2	
1998	Hildebrandt et al.	White roofs		17	---	39																						x		3	
2002	Sonne et al.	Flexible roofing facility	8	---	---	38																					x			2	
1997	Akbari et al.	High-albedo roofs		25	---	35																					x			3	
1998	Petrie et al.	Radiant barriers			34																						x			2	
1998	Akridge	Albedo roofs	9	---	28																							x			
2002	Parker et al.	Various roofing systems	3	---	26					3	---	---	35															x			2
2000	Parker et al.	Different roofing systems	3	23						5	---	34																x			2
1998	Parker et al.	Reflective roofing systems		19																								x			2
1988	Taha et al.	Heat islands	14	19						14	---	---	35																		3
1990	Levins & Herron	Radiant barriers	3	17												11	19											x			3
1996	Hageman & Modera	Low-emissivity roof sheathing		16																								x			2
2003	Parker et al.	Flexible roofing facility	2	15																								x			2
1995	McLain & Christian	Roof re-covering	10																										x		
1996	Parker et al.	Roof coloring	10										35																x		2
1998	Parker et al.	White roofs	10									30																	x		2
1998	Rosenfeld et al.	Heat islands	10																												3
1998	Moujaes & Brickman	Radiant barriers	9								16																	x			2
1999	Moujaes & Brickman	Radiant barriers	9								16																	x			2
1990	Levins & Hall	Radiant barriers	7																									x			4
1998	Petrie et al.	Radiation control coatings on roofs	7																										x		2
2000	Parker & Sherwin	Photovoltaic attic ventilator fans	6																									x			2

of Papers by Climatic Zone

of Papers by Method

of Papers by Cooling Energy Savings (%)

of Papers by Peak Cooling Savings (%)

of Papers by Heating Energy Savings (%)

of Papers by Applications

Table 1. Cool Roof Literature Survey Reporting Quantitative Results

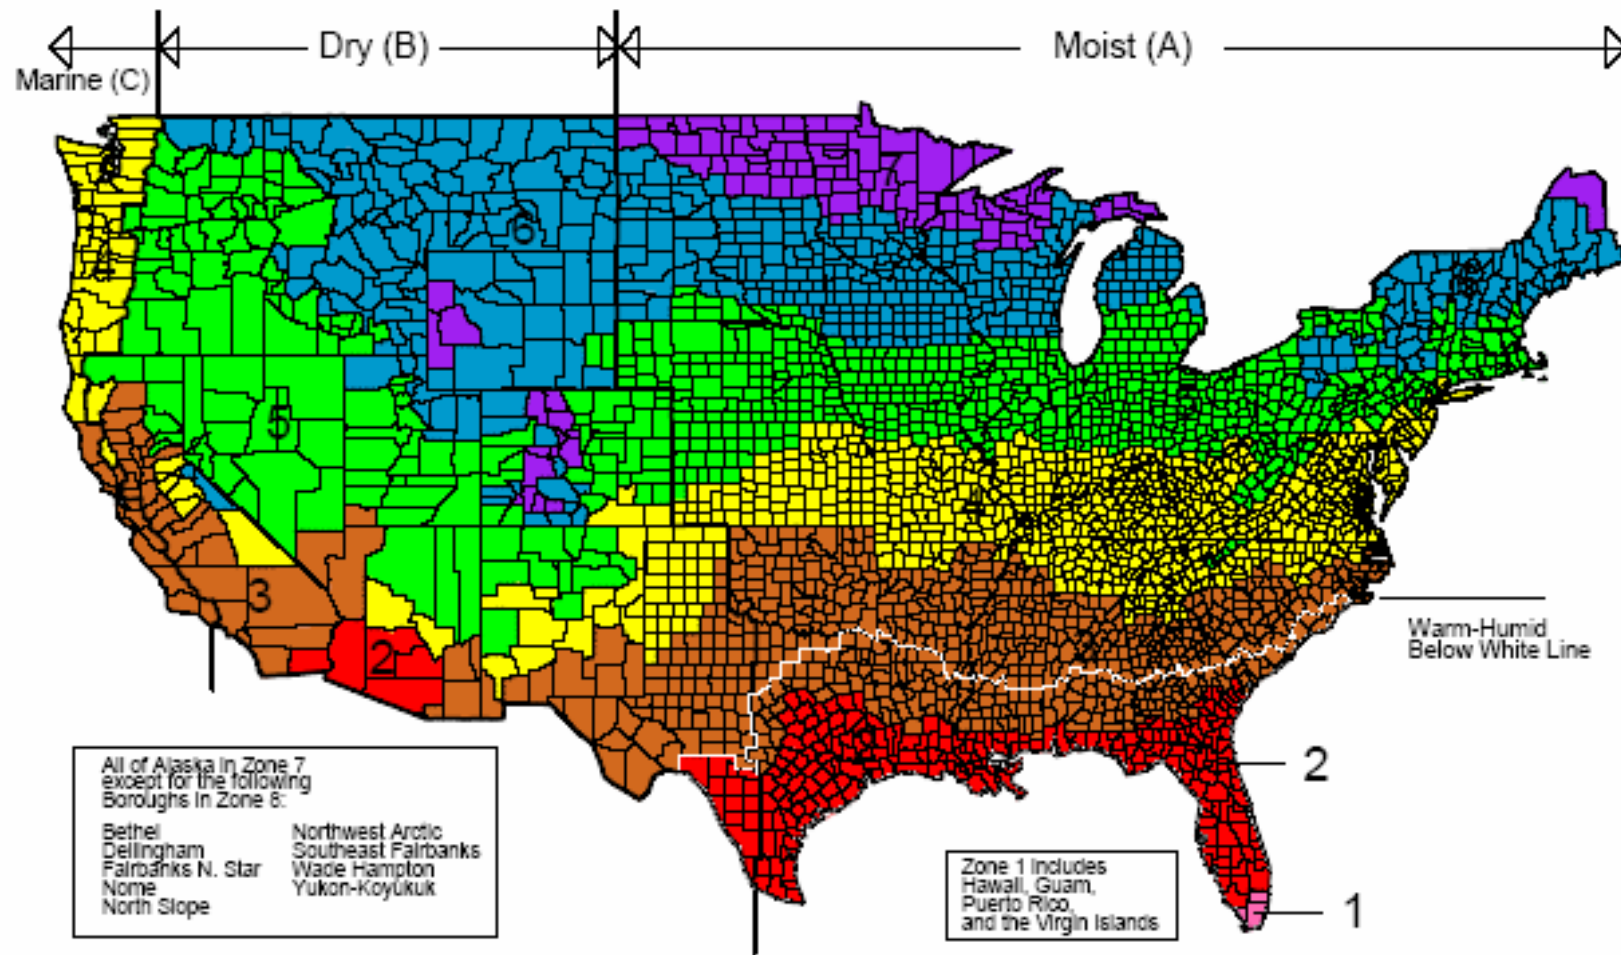


Figure 1. Map of DOE's Proposed Climate Zones (DOE, 2003)

Heating energy savings of 11% through 19% were reported (Levins and Herron, 1990) by implementing radiant barrier systems, which can reduce heat fluxes and, as a result, can reduce heat loss to the attic and to the outside of a building in the winter weather condition. One paper reported heating savings of 50%, which was stated to be an impact of the roof re-covering, rather than the cool roof systems alone.

More than half (fifteen) of the papers showing energy savings from cool roofs implemented white roof systems. Eight papers used radiant barrier systems for cool roofs. The applications of the cool roof systems were performed on different building types; eighteen papers were results from residential buildings, seven papers reported results from commercial buildings. No literature could be found on strictly industrial buildings that had quantitative savings. The implementation of cool roof systems was carried out in different climate conditions. However, as shown in the last column, the majority of the papers were based on Zone 2 – a hot-humid climate, as illustrated in Figure 1, which shows the all seven climate zones in the United States as reported by U.S. Department of Energy.

Table 2 shows heat flux/gain reductions from implementing cool roof systems. Four of nine papers that reported quantitative results applied the white roof systems and showed heat flux reductions in the 20% to 72% range. Radiant barrier systems, used in four of the papers reviewed, had reduced heat gains from 8% to 98%. Photovoltaic roof systems were even utilized for cool roofs, and were reported to decrease cooling load by as much as 35% on a conventional roof. Applications for the papers shown in Table 2 were mainly to the residential buildings (seven of nine papers). One paper applied the white roof systems to the commercial buildings along with the residential buildings.

Table 3 is a list of the papers that contained only qualitative results for the cool roof systems. Thirty five papers showed cooling energy savings, two papers peak cooling savings, and five papers heating contained savings from cool roofs. Applications were also mainly to the residential buildings; seventeen papers to the residential buildings, four papers to the commercial buildings, and two papers to the industrial buildings.

Cooling energy savings were also mentioned from the papers that focused primarily on the urban heat island effect. These papers mentioned that the cool roof systems contribute to the reduction of the heat island effect. Realistically there are many more papers about the heat island effect along with cooling energy savings from the cool roof systems than seven papers shown in Table 3. However, most of the papers focused on the impact that the highly reflective surfaces would have on the surrounding environment, versus the impact on the conditioned space in the building directly below the cool roof. The reader is referred to the Heat Island Group at LBNL for a more details about this analysis.

Figure 2, Figure 3, Figure 4, Figure 5, and Figure 6 are included in this literature review to help illustrate the different heat transfer mechanism at work in an attic.

Year	Authors	Methods	Description of Heat Flux / Gain Reductions	Heat Flux / Gain Reductions (%)							Applications			Climatic Zones
				10	20	30	40	50	60	70	Res.	Com.	Ind.	
2004	Medina	Radiant barriers	Ceiling heat flux reduction from 39.7% to 97.7%				40	---	---	100				3
1998	Akbari & Konopacki	Roof albedo and emissivity	Changing Roof Emissivity from 0.9 to 0.25 (72% reduction)							72	x	x		all
1995	Beal & Chandra	Tile roofs / Attic ventilation	Heat flux reduction of 25% - 66%			25	---	---	---	66	x			2
2000	Medina	Radiant barriers & Attic insulation	Heat flow reduction of 23% - 44%	23	---	44					x			2
1996	Al-Asmar et al.	Radiant barriers	Attic heat gain reduction of 17%-26% (With ventilation) & 24%-42% (Without ventilation)	24	---	42					x			
2001	Yang et al.	Photovoltaic roofs	Cooling load component through a PV roof is about 35% of a conventioanl roof.				35				x			
1998	Parker & Sherwin	White roofs	Average ceiling heat flux reduction of 23%	23							x			2
1999	Holton & Beggs	Plastic shake roofs	20% cooler roof	20							x			5
1993	Wilkes & Childs	Radiant barriers (Winter Condition)	Radiant barrier decreases the ceiling heat flow by 6% to 8%.	8										







Table 2. Cool Roof Literature Survey Reporting Heat Flux Qualitative Results

Year	Authors	Methods	Energy Savings (●: Qualitative & ○: Mention)				Applications			Heat Island	Climatic Zone
			Cooling	Peak Cooling	Heating	Annual Consumption	Res.	Com.	Ind.		
1985	Griggs & Courville	Roof insulation or coloring	○		○						12 different cities
1987	White et al.	Roof mist spray system	○								
1987	Levins & Karnitz	Radiant barriers	●		●		x				4
1988	Somasundaram & Carrasco	Roof spray cooling	○					x	x		
1989	MacDonald et al.	White roofs	○	○	○	○	x	x	x		all
1989	Wu	Radiant barriers	○				x				2
1989	Ober	Radiant Barrier performance Test	○				x				2
1989	Stewart et al.	Radiant barriers	○								
1989	Wilkes	Radiant barriers	○								
1992	Grondzik	Roof assemblies	○				x				2
1992	Chen et al.	radiant barrier systems in reducing heat loss through the ceiling			○		?				7
1992	Kochhar et al.	Roof coating	○				x				2
1994	Byerley & Christian	Radiation control coatings on roofs	○								
1996	Moujaes S.	Radiant barriers	○				x				
1996	Moujaes	Radiant barriers	○				x				
1996	Gartland et al.	Reflective roofing	○								
1997	Bretz & Akbari	High-albedo roofs	○				x				2 & 3
1998	Akbari	White roofs	○	○			x	x			2 & 3
1998	Parker & Sherwin	White roofs	●				x				2
1998	Rudd & Lstiburek	Attic ventilation	○				x				2
1998	Proctor	Attic ventilation	○				x				4
1998	Parker & Sherwin	Attic temperature measurements with different cool roof systems	○				x				2
1998	Bretz et al.	Heat islands	●							x	3
2000	Parker et al.	Test of roofing materials	○								
2000	Akbari et al.	Reflective roofs	○				x				2
2001	Kriner et al.	White painted roofs	●		●		x	x			2
2001	Rose	Various roof assemblies	○				x				
2002	PG&E	Cool roofs	○								3
2002	Akbari & Pomerantz	Heat islands	○							x	
2002	Dietsch et al.	Heat islands	○							x	
2002	Wong & Mercado	Heat islands	○							x	
2002	Griffiths et al.	Heat islands	○							x	
2002	Miller et al.	Cool color roofs	○								
2003	Miranville et al.	Radiant barriers	○								2
2004	Akbari & Konopacki	Heat islands	●							x	Toronto, Canada
2005	Levinson et al.	Cool roofs	○							x	3

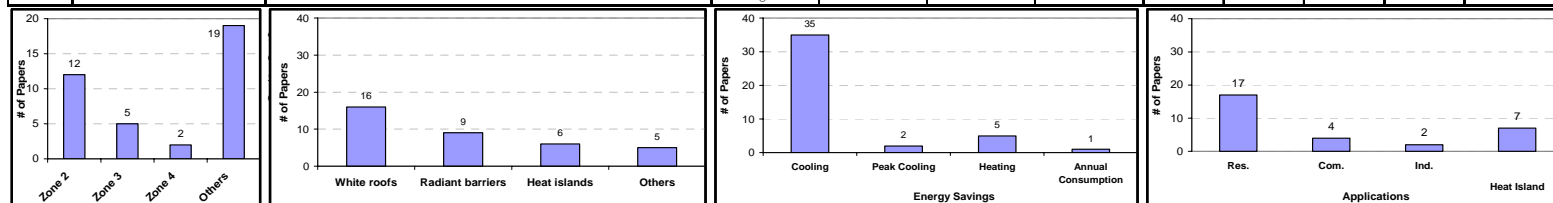


Table 3. Qualitative Analysis of Cool Roof Literature Survey

In Figure 2 from the Whole-building Design Guide (2004), a generalized illustration is provided that shows the basic heat transfer interactions at the roof surface. First, solar radiation is either reflected, or absorbed, depending upon the characteristics of the roof's surface. In the case that solar energy is absorbed, some of this heat is transferred into the inside of the building as "net heat flux", some is re-radiated, or re-emitted to the sky, some is carried away by convection. Clearly, in Figure 2 one can see that there are numerous thermal mechanisms at work in the attic, which is reflected in the diverse results from the literature review.

In Figure 3, from the Florida Solar Energy Center (FSEC 2004a), the heat transfer mechanisms for a roof with an attic are shown. In this figure, the basic heat transfer mechanisms shown in Figure 2 are further complicated by the attic and the ductwork in the attic. First, in the attic it is shown that the insulation is placed above the horizontal ceiling that separates the attic from the living space below. Unfortunately, in many houses this insulating layer is penetrated by the insulated ductwork that delivers the cooling to the space from the air conditioning system. In Figure 3 the cooling unit is shown in the conditioned space. However, in many houses, this unit is also in the attic, which can compound the heat gain from the hot attic. This figure shows why it is important that the researchers identify whether or not there were ducts in the attic, how much insulation those ducts had, and if there was any leakage to/from the duct into the attic. In general, in the studies that showed the most savings from cool roofs, there was either very little insulation in the ceiling, poorly insulated ducts, leaky ducts or some combination of the above. In those studies that showed very little savings from the cool roofs, there was usually significant insulation, insulated and sealed ducts, or the ducts were placed below the insulated ceiling.

In Figure 4 from the Home Energy Magazine (HEM 2004a), a horizontal placement for the radiant barrier is shown. Although this is the easiest placement of the radiant barrier, it suffers the most from dust deposition that can degrade the reflective nature of the radiant barrier. In Figure 5, also from the Home Energy Magazine (HEM 2004b), the most common placement of radiant barriers is shown. In most cases, this is attached to the lower side of the rafters that support the sloped portion of the upper roof. This placement is usually preferred due to its reduced dust deposition that can degrade the reflective nature of the radiant barrier.

In Figure 6 from FSEC (2004b), all three of the most common placement methods are shown, including: 1) the bottom side of the sheathing of the roof decking, 2) attached to the bottom cord of the truss, or 3) in the horizontal position on top of the insulation on the ceiling.

Energy Balance on Roof Surface

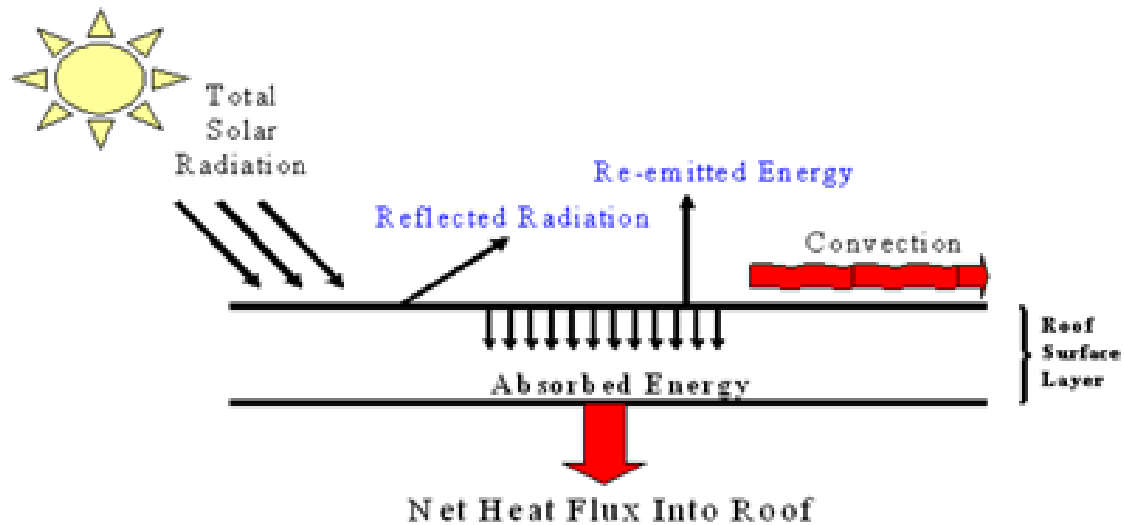


Figure 2. Energy Balance on Roof Surface (WBDG, 2004)

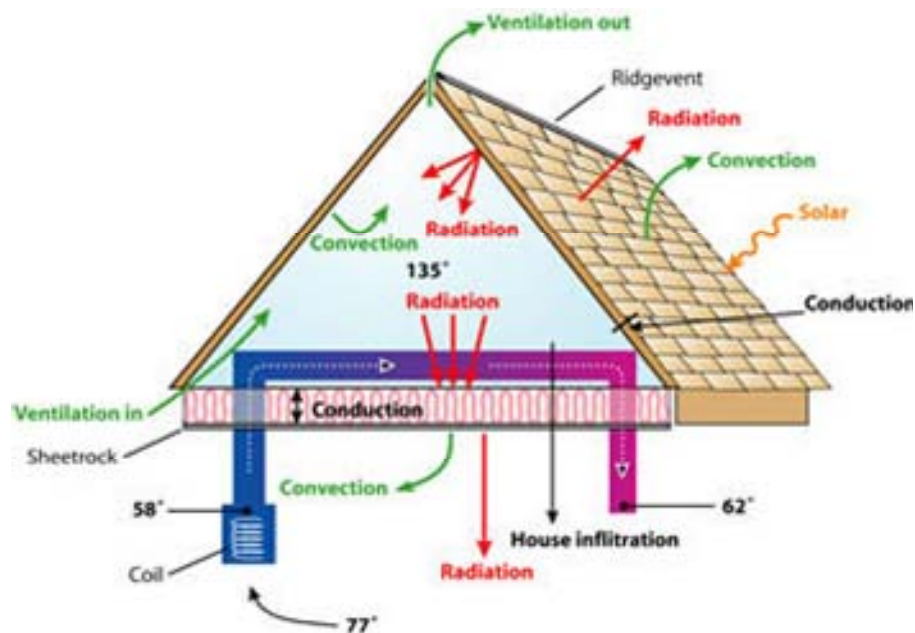


Figure 3. Vented Attic Thermal Processes (FSEC, 2004a)

Horizontal Radiant Barrier Configuration

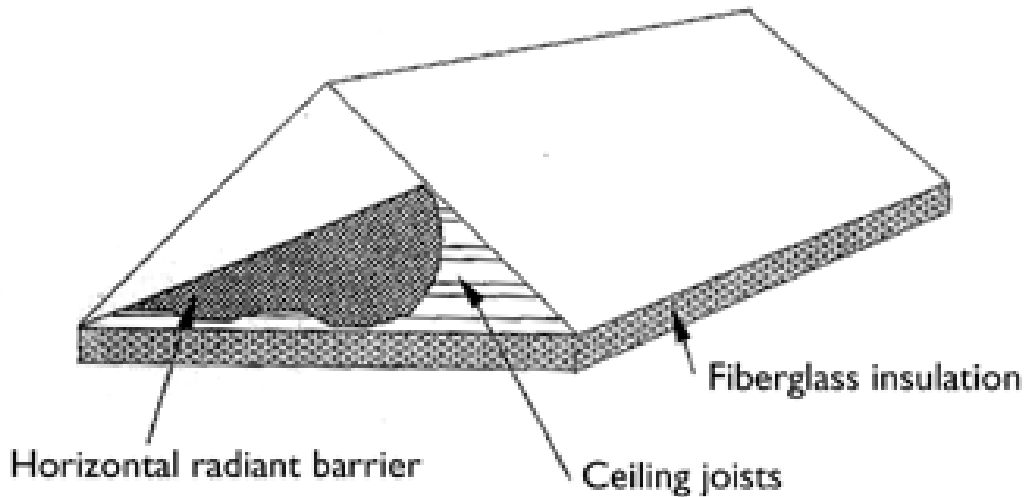


Figure 4. The barrier is installed horizontally over the attic frame. (HEM, 2004a)

Truss Radiant Barrier Configuration

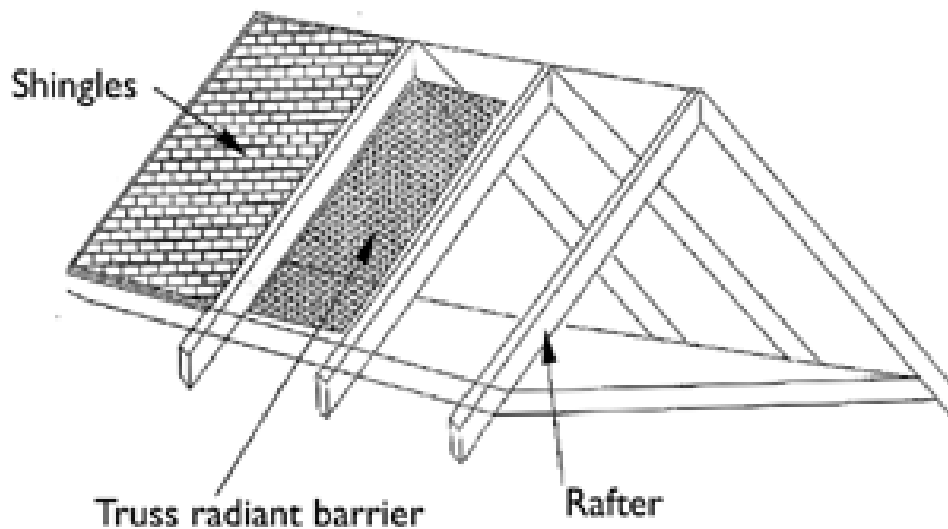


Figure 5. The barrier is attached to the rafters that support the deck. (HEM, 2004b)

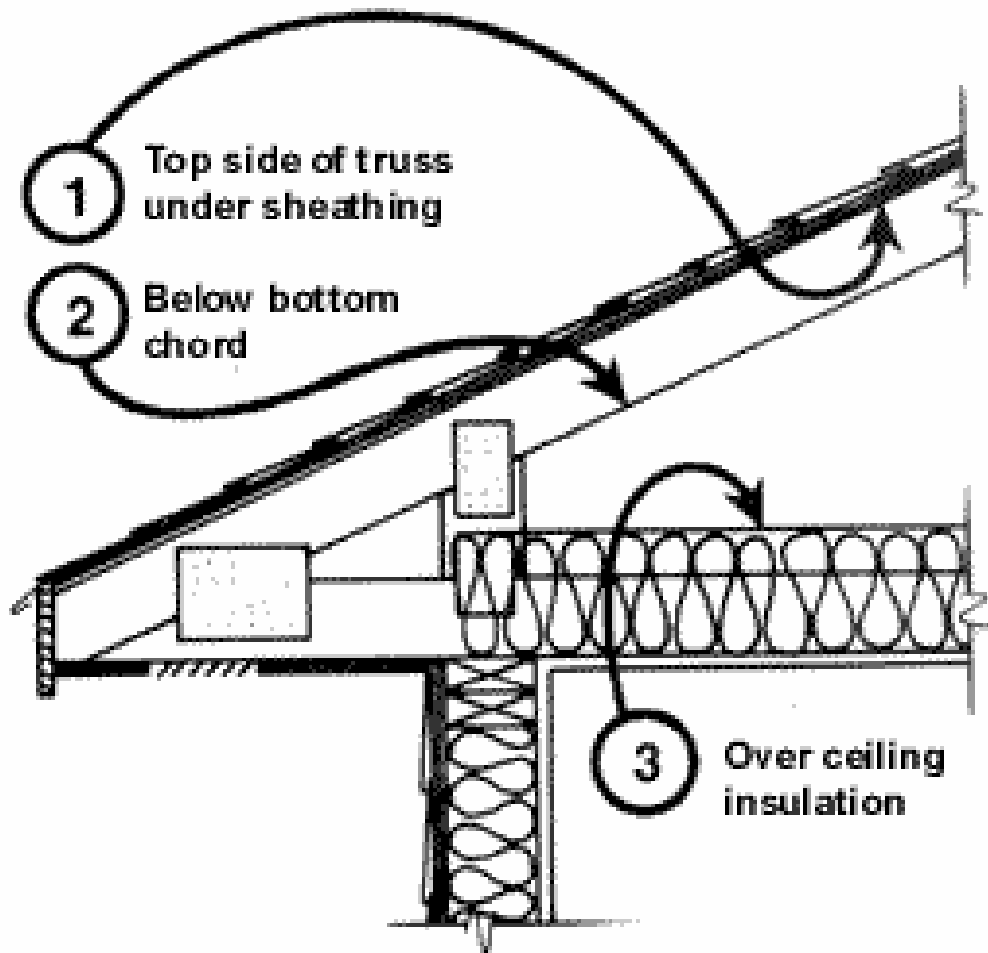


Figure 1. Typical attic section with three possible locations for radiant barrier.

Figure 6. Typical Attic Section with Three Possible Locations for Radiant Barrier. (FSEC, 2004b)

3 References

- Akbari, H., Bretz, S., Kurn, D.M., Hanford, J. 1997. Peak power and cooling energy savings of high-albedo roofs. *Energy and Buildings*, Vol. 25, pp. 117-126.
- Akbari, H. 1998. Cool Roofs Save Energy. *ASHRAE Transactions*, Vol. 104, Pt. 1B, pp. 783-788.
- Akbari, H., Konopacki, S.J. 1998. The Impact of Reflectivity and Emissivity of Roofs on Building Cooling and Heating Energy Use. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VII*, pp. 29-4039.
- Akbari, H., Pomerantz, M. 2002. Implementation of Heat Island Reduction Measures: Where We Are and Where We Need to Go. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 9.1-9.13.
- Akbari, H., Konopacki, S. 2004. Energy effects of heat-island reduction strategies in Toronto, Canada. *Energy*, Vol. 29, pp. 191–210.
- *Akridge, J.M. 1998. High-Albedo Roof Coatings-Impact on Energy Consumption. *ASHRAE Transactions*, Vol. 104, Pt. 1.
- Al-Asmar, H.R., Jones, B.W., Matteson, D.K. 1996. Experimental Evaluation of Attic Radiant Barriers. *ASHRAE Transactions*, Vol. 102, Pt. 1, pp. 297-306.
- Beal, D., Chandra, S. 1995. The measured summer performance of tile roof systems and attic ventilation strategies in hot, humid climates. *Proceedings of the ASHRAE Conference: Thermal Performance of the Exterior Envelopes of Buildings VI*, pp. 753-760.
- Bourne, R.C., Rainer, L.I. 1992. A water-ballasted lifetime energy-saving roof system - economic projections. *Proceedings of the ASHRAE/DOE/BTECC Conference: Thermal Performance of the Exterior Envelopes of Buildings V*, pp. 445-453.
- Bretz, S. E., Akbari, H. 1997. Long-term performance of high-albedo roof coatings. *Energy and Buildings*, Vol. 25, pp. 159-167.
- Bretz, S., Akbari, H., Rosenfeld, A. 1998. Practical Issues for Using Solar-reflective Materials to Mitigate Urban Heat Islands. *Atmospheric Environment*, Vol. 32, Pt. 1, pp. 95-101.
- Byerley, A.R., Christian, J.E. 1994. The Long Term Thermal Performance of Radiation Control Coatings. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 5.60 - 5.71.

- Chasar, D., Moyer, N., Rudd, A.F., Parker, D., Chandra, S. 2002. Measured and Simulated Cooling Performance Comparison: Insulated Concrete Form versus Frame Construction. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 1.43 - 1.52.
- Chen, H., Larson, T., Erickson, R.W. 1992. The performance of an attic radiant barrier for a simulated Minnesota winter. *Proceedings of the ASHRAE/DOE/BTECC Conference: Thermal Performance of the Exterior Envelopes of Buildings V*, pp. 114-122.
- Conroy, C.L., Mumma, S.A. 2001. Ceiling Radiant Cooling Panels as a Viable Distributed Parallel Sensible Cooling Technology Integrated with Dedicated Outdoor Air Systems. *ASHRAE Transactions*, Vol. 107, Pt. 1, pp. 571-579.
- Delp, W.W., Matson, N.E., Tschudy, E., Modera, M.P., Diamond, R.C. 1998. Field Investigation of Duct System Performance in California Light Commercial Buildings. *ASHRAE Transactions*, Vol. 104, Pt. 1B, pp. 783-788.
- Department of Energy (DOE) Website. 2003.
http://www.energycodes.gov/implement/pdfs/color_map_climate_zones_Mar03.pdf
- Dietsch, N., Bell, R., Drumheller, B. 2002. Emphasizing the Co-Benefits of Heat Island Mitigation: Lessons from U.S. Local Governments Engaged in Climate Protection. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 9.71-9.82.
- Environmental Protection Agency (EPA) Website. 2004.
<http://www.epa.gov/heatisland/strategies/coolroofs.html>
- Florida Solar Energy Center (FSEC) Website. 2004a.
<http://www.fsec.ucf.edu/bldg/pubs/coolroof/>
- Florida Solar Energy Center (FSEC) Website. 2004b.
<http://www.fsec.ucf.edu/pubs/energynotes/en-15.htm>
- Gartland, L.M., Konopacki, S.J., Akbari, H. 1996. Modeling the Effects of Reflective Roofing. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 4.117-4.124.
- Griffiths, D., Aldrich, R., Zoeller, W., Zuluaga, M. 2002. An Innovative Approach to Reducing Duct Heat Gains for a Production Builder in a Hot and Humid Climate—How We Got There. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 1.81-1.90.
- Griggs, E.I., Courville, G.E. 1985. Changes in building heating and cooling requirements due to a reduction in the roofs solar absorptance. *Proceedings of the ASHRAE/DOE/BTECC Conference: Thermal Performance of the Exterior Envelopes of Buildings III*, pp. 1042-1059.

Grondzik, W.T. 1992. Measured performance of ten roof assemblies in a hot, arid climate. *Proceedings of the ASHRAE/DOE/BTECC Conference: Performance of the Exterior Envelopes of Buildings V*, pp. 457-464.

Hageman, R.K., Modera, M.P. 1996. Energy Savings and HVAC Capacity Implications of a Low-Emissivity Interior Surface for Roof Sheathing. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 1.117-1.130.

Hens, H., Janssens, A. 1998. Application of a New Type of Air and Vapor Retarder in a Self-Drying Sloped Roof with a Cathedral Ceiling. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Performance of the Exterior Envelopes of Buildings VII*, pp. 15-28.

Hildebrandt, E.W., Bos, W., Moore, R. 1998. Assessing the Impacts of White Roofs on Building Energy Loads. *ASHRAE Transactions*, Vol. 104, Pt. 1B, pp. 810-818.

Holton, J. K., Beggs, T.R. 1999. Test and Evaluation of the Attic Temperature Reduction Potential of Plastic Roof Shakes. *ASHRAE Transactions*, pp. 858-866.

Home Energy Magazine (HEM) Website. 2004a.
<http://hem.dis.anl.gov/eehem/00/000915.html>

Home Energy Magazine (HEM) Website. 2004b.
<http://hem.dis.anl.gov/eehem/00/000915.html>

Kochhar, G.S., Osborne, R.W.A., Lewis, E.R. 1992. Enhancement of thermal performance of domestic roofing system for tropical climates. *Proceedings of the ASHRAE/DOE/BTECC Conference: Thermal Performance of the Exterior Envelopes of Buildings V*, pp. 429-439.

Kriner; S.A., Miller, W.A., Desjarlais, A.O. 2001. The Thermal Performance of Painted and Unpainted Standing-Seam Metal Roofing Systems Exposed to Two Years of Weathering. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VIII*, pp. 115-131.

Levins, W.P., Karnitz, M.A. 1987. Energy measurements of single-family houses with attics containing radiant barriers. *ASHRAE Transactions*, Vol. 93, Pt. 2, pp. 182-199.

Levins, W.P., Karnitz, M.A., Hall, J.A. 1989. Moisture measurements in single-family houses with attics containing radiant barriers. *ASHRAE Transactions*, Vol. 95, Pt. 2, pp. 235-243.

Levins, W.P., Herron, D.L. 1990a. Radiant Barrier Field Tests in Army Family Housing Units at Fort Benning, Georgia. *ASHRAE Transactions*, Vol. 96 Pt. 2, pp. 589-597.

Levins, W.P., Hall, J.A. 1990b. Measured Effects of Dust on the Performance of Radiant Barriers Installed on Top of Attic Insulation. *ASHRAE Transactions*, Vol. 96, Pt. 2, pp. 253-260.

- Levinson, R., Akbari, H., Konopacki, S., Bretz, S. 2005. Inclusion of cool roofs in nonresidential Title 24 prescriptive requirements. *Energy Policy*, Vol. 33, pp. 151–170.
- MacDonald, J.M., Courville, G.E., Griggs, E.I. 1989. A guide for estimating potential energy savings from increased solar reflectance of a low-sloped roof. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings IV*, pp. 348-357.
- McLain, H.A., Christian, J.E. 1995. An office building used as a federal test bed for energy-efficient roofs. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VI*, pp. 353-366.
- Medina, M.A. 2000. On the performance of radiant barriers in combination with different attic insulation levels. *Energy and Buildings*, Vol. 33, pp. 31-40.
- Medina, M.A. 2004. Radiant barrier performance estimation for the state of California. Report Prepared for ADM & Associates.
- Merkel, H. 2001. Inverted Roofs with Reduced Heat Losses Due to a Water-Repellent Separating Layer. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VIII*, pp. 24-39.
- Miller, W.A., Loye, K.T., Desjarlais, A.O., Blonski, R.P. 2002. Cool Color Roofs with Complex Inorganic Color Pigments. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 1.195 - 1.206.
- Miranville, F., Boyer, H., Mara, T., Garde, F. 2003. On the thermal behavior of roof-mounted radiant barriers under tropical and humid climate conditions: Modeling and empirical validation. *Energy and Buildings*, Vol. 35, pp. 997-1008.
- Moujaes, S. 1996. Use of Passive Radiation Barriers in Ventilated Attics. *ASHRAE Transactions*, Vol. 102, Pt. 1, pp. 307-314.
- Moujaes, S.F., Brickman, R.A. 1998. Effect of a Radiant Barrier on the Cooling Load of a Residential Application in a Hot and Arid Region: Attic Duct Effect. *HVAC&R Research*, Vol. 4, No. 3, pp. 231-244.
- Noboa, H., O'Neal, D., Turner, W.D. 1994. A Model of the Effect of Dust on the Emissivity of Radiant Barriers. *ASHRAE Transactions*, Vol. 100, Pt. 2, pp. 23-30.
- Ober, D.G. 1989. Full-scale radiant barrier tests in Ocala, Florida, Summer 1988. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings IV*, pp. 286-293.
- Parker, D.S. 1992. Measured Natural Cooling Enhancement of a whole House Fan. *Rept. to the Florida Solar Energy Center, Cocoa, FL*, FSEC-PF-273-92.

Parker, D.S., Cummings, J.B., Sherwin, J.R., Stedman, T.C., McIlvaine, J.E.R. 1994. Measured Residential Cooling Energy Savings from Reflective Roof Coatings in Florida. *ASHRAE Transactions*, Vol. 100, Pt. 2, pp. 36-49.

Parker, D.S., Barkaszi, S.F., Chandra, S., Beal, D.J. 1995. Measured cooling energy savings from reflective roofing systems in Florida. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VI*, pp. 489-500.

Parker, D.S., Sherwin, J.R., Sonne, J.K., Barkaszi, Jr., S.F. 1996. Demonstration of cooling savings of light colored roof surfacing in Florida commercial buildings: Our Savior's School. *Rept. to the Florida Solar Energy Center, Cocoa, FL*, FSEC-CR-904-96.

Parker, D.S., Barkaszi, Jr., S.F. 1997a. Roof solar reflectance and cooling energy use: Field research results from Florida. *Energy and Buildings*, Vol. 25, pp. 105-115.

Parker, D.S., Sonne, J.K., Sherwin, J.R. 1997b. Demonstration of cooling savings of light colored roof surfacing in Florida commercial buildings: Retail Strip Mall. *Rept. to the Florida Solar Energy Center, Cocoa, FL*, FSEC-CR-964-97.

Parker, D.S., Huang, Y.J., Konopacki, S.J., Gartland, L.M., Sherwin, J.R., Gu, L. 1998a. Measured and Simulated Performance of Reflective Roofing Systems in Residential Buildings. *ASHRAE Transactions*, Vol. 104, Pt. 1, pp. 963-975.

Parker, D.S., Sherwin, J.R. 1998b. Comparative Summer Attic Thermal Performance of Six Roof Constructions. *ASHRAE Transactions*, Vol. 104, Pt. 2, pp. 1084-1092.

Parker, D., Sherwin, J. 1998c. Monitored Summer Peak Attic Air Temperatures in Florida residences. *Rept. to the Florida Solar Energy Center, Cocoa, FL*, FSEC-PF336-98.

Parker, D.S., Sherwin, J.R., Sonne, J.K. 1998d. Measured Performance of a Reflective Roofing System in a Florida Commercial Building. *ASHRAE Transactions*, Vol. 104, Pt. 1B, pp. 789-794.

Parker, D.S., McIlvaine, J.E.R., Beal, S.F., Anello, M.T. 2000. Laboratory testing of the reflectance properties of roofing materials. *Rept. from the Florida Solar Energy Center, Cocoa, FL*, FSEC-670-00.

Parker, D., Sherwin, J. 2000. Performance Assessment of Photovoltaic Attic Ventilator Fans. *Proceedings of the Twelfth Symposium on Improving Building Systems in Hot and Humid Climates*, pp. 411-415.

Parker, D.S., Sonne, J.K., Sherwin, J.R. 2002. Comparative Evaluation of the Impact of Roofing Systems on Residential Cooling Energy Demand in Florida. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 1.219-1.234.

- Parker, D.S., Sonne, J.K., Sherwin, J.R. 2003. Flexible Roofing Facility: 2002 Summer Test Results. *Prepared for U.S. Department of Energy Building Technologies Program.*
- Petrie, T.W., Wilkes, K.E., Childs, P.W., Christian, J.E. 1998a. Effects of Radiant Barriers and Attic Ventilation on Residential Attics and Attic Duct Systems: New Tools for Measuring and Modeling. *ASHRAE Transactions*, Vol. 104, Pt. 2, pp. 1175-1193.
- Petrie, T.W., Childs, P.W., Christian, J.E. 1998b. Radiation Control Coatings on Rough-Surfaced Roofs at a Federal Facility: Two Summers of Monitoring Plus Roof and Whole Building Modeling. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VII*, pp. 353-372.
- Phalen, T.E. 1989. The influence of lightweight concrete ballast on energy conservation on single-ply roof systems. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings IV*, pp. 157-171.
- Procto, J. 1998. Monitored In-Situ Performance of Residential Air-Conditioning Systems, *ASHRAE Transactions*, Vol. 104, Pt. 1B, pp. 1833-1840.
- Rose, W.B. 2001. Measured Summer Values of heating and Shingle Temperatures for Residential Attics and Cathedral Ceilings. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VIII*, pp. 123-139.
- Rose, W.B., TenWolde, A. 2002. Venting Of Attics & Cathedral Ceilings. *ASHRAE Journal*, Vol. 44, No. 10, pp. 26-33.
- Rosenfeld, A.H., Akbari, H., Bretz, S., Fishman, B.L., Kurn, D.M., Sailor, D., Taha, H. 1995. Mitigation of urban heat islands: materials, utility programs, updates. *Energy and Buildings*, Vol. 22, pp. 255-265.
- Rosenfeld, A.H., Akbari, H., Romm, J.J., Pomerantz, M. 1998. Cool communities: Strategies for heat island mitigation and smog reduction. *Energy and Buildings*, Vol. 28, pp. 51-62.
- Rudd, A.F., Lstiburek, J.W. 1998. Vented and Sealed Attics in Hot Climates. *ASHRAE Transactions*, Vol. 104, Pt. 2, pp. 1199-1210.
- Siegel, J.A., McWilliams, J.A., Walker, I.S. 2003. Comparison between Predicted Duct Effectiveness from Proposed ASHRAE Standard 152P and Measured Field Data for Residential Forced Air Cooling Systems. *ASHRAE Transactions*, Vol. 109, Pt. 1, pp. 503-512.
- Somasundaram S., Carrasco, A.D. 1988. An experimental and numerical modeling of a roof-spray cooling system. *ASHRAE Transactions*, Vol. 94, Pt. 2, pp. 1091-1107.

Sonne, J.K., Parker, D.S., Sherwin, J.R. 2002. Flexible Roofing Facility: 2001 Summer Test Results. *Rept. to the Florida Solar Energy Center, Cocoa, FL*, FSEC-CR-1336-02.

Stewart, W.E., Becker, B.R., Stickler, L.A., Greer, M.E. 1989. Approximate attic air temperatures and ceiling heat fluxes with radiant barriers. *ASHRAE Transactions*, Vol. 95, Pt. 2, pp. 244-249.

Taha, H., Akabari, H., Rosenfels, A., Huang, J. 1988. Residential cooling loads and the urban heat island on the effects of albedo. *Building and Environment*, Vol. 23, No. 4, pp. 271-283.

White, C.R., Hanley, T.R., Mathiasmeier, K.J. 1987. Heat transport model for roof mist spray systems. *ASHRAE Journal*, Vol. 29, No. 10, pp. 39-41.

Whole Building Design Guide (WBDG) Website. 2004.
<http://www.wbdg.org/design/resource.php?cn=0&rp=46>

Wilkes, K.E. 1989. Thermal modeling of residential attics with radiant barriers, comparison with laboratory and field data. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings VII*, pp. 294-311.

Wilkes, K.E., Childs, P.W. 1993. Thermal Performance of Clean Horizontal Radiant Barriers under Winter Conditions: Laboratory Measurements and Mathematical Modeling. *ASHRAE Transactions*, Vol. 99, Pt. 1, pp. 603-613.

Wong, E., Mercado, E. 2002. Opportunities to Advance Heat Island Mitigation Policy. *Proceedings of the ACEEE Summer Study on Energy Efficiency in Buildings*, pp. 9.395-9.406.

Wu, H. 1987. In situ measurement of attic radiant barrier performance in hot, arid climates, *Proceedings of the ASHRAE Far East Conference on Air Conditioning in Hot Climates*, pp. 83-90.

Wu, H. 1989. The effect of various attic venting devices on the performance of radiant barrier systems in hot, arid climates. *Proceedings of the ASHRAE/DOE/BTECC/CIBSE Conference: Thermal Performance of the Exterior Envelopes of Buildings IV*, pp. 261-270.

Yang, H., Zhu, Z., Burnett, J., Lu, L. 2001. A Simulation Study on the Energy Performance of Photovoltaic Roofs. *ASHRAE Transactions*, Vol. 107, Pt. 2, pp. 129-135.